**CUI** DEVICES

date 01/22/2020

page 1 of 4

MODEL: CPS-5449-105PM | DESCRIPTION: SIREN

#### **FEATURES**

- sweeping tone
- internally driven
- panel mount





### **SPECIFICATIONS**


OI LOII IOAIIONO					
parameter	conditions/description	min	typ	max	units
rated voltage			24		Vdc
operating voltage		10		28	Vdc
current consumption	at rated voltage		150		mA
rated frequency		1,500		3,500	Hz
sound pressure level	at 1 m, rated voltage		95		dB
tone	sweep 3.3				
dimensions	Ø54.0 x 47.0				mm
weight			62.0		g
material	ABS				
terminal	wire leads				
operating temperature		-20		70	°C
storage temperature		-30		80	°C
washable	no				
RoHS	yes				

Notes: 1. All specifications measured at 25±3°C, humidity at 60~70%, under 86~106 kPa pressure, unless otherwise noted.

## **MECHANICAL DRAWING**

units: mm tolerance: ±3 mm


wire: UL 2468 24 AWG

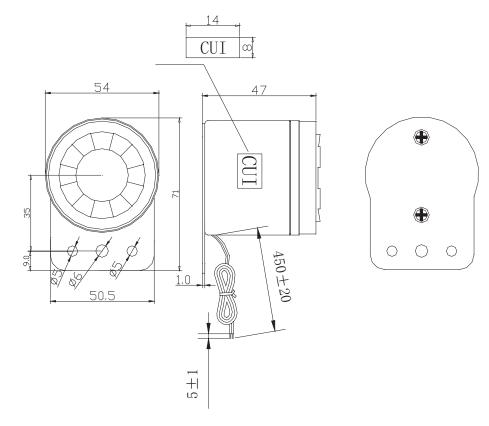


#### **PACKAGING**

units: mm

Carton Size: 360 x 335 x 280 mm Carton QTY: 140 pcs per carton

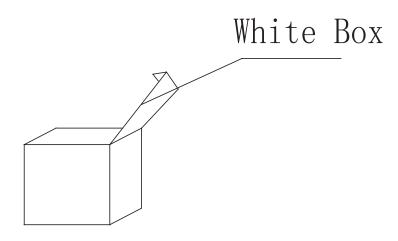

1 PCS One BOX

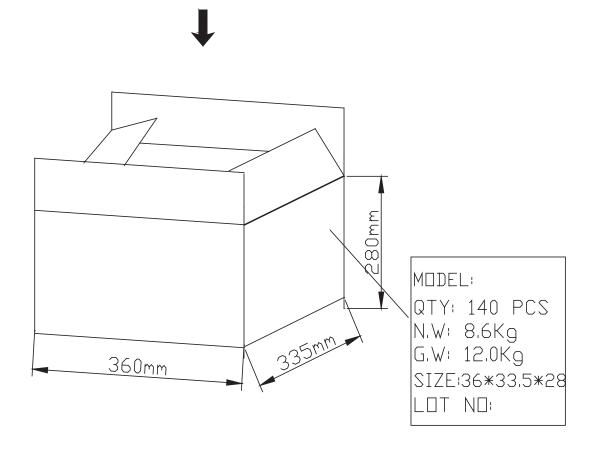

Additional Resources: Product Page

CUI Devices | MODEL: CPS-5449-105PM | DESCRIPTION: SIREN date 01/22/2020 | page 4 of 4

#### **REVISION HISTORY**

rev.	description	date	
1.0	initial release	01/22/2020	

The revision history provided is for informational purposes only and is believed to be accurate.

# **CUI** DEVICES

CUI Devices offers a one (1) year limited warranty. Complete warranty information is listed on our website.

CUI Devices reserves the right to make changes to the product at any time without notice. Information provided by CUI Devices is believed to be accurate and reliable. However, no responsibility is assumed by CUI Devices for its use, nor for any infringements of patents or other rights of third parties which may result from its use.

CUI Devices products are not authorized or warranted for use as critical components in equipment that requires an extremely high level of reliability. A critical component is any component of a life support device or system whose failure to perform can be reasonably expected to cause the failure of the life support device or system, or to affect its safety or effectiveness.